




Handwritten text on the transformer cover:
KB 251M122 + 10A1 0202
2P15KV4 22K-32
Tr # 1129-32
Tr # 2001
From
2020.07.05
D50
Lcing

Handwritten text on the fire extinguisher label:
CAUTION
Carbon dioxide fire ext



PH1616122
T8A 1978
8122 1186
T02 1186
Konchay

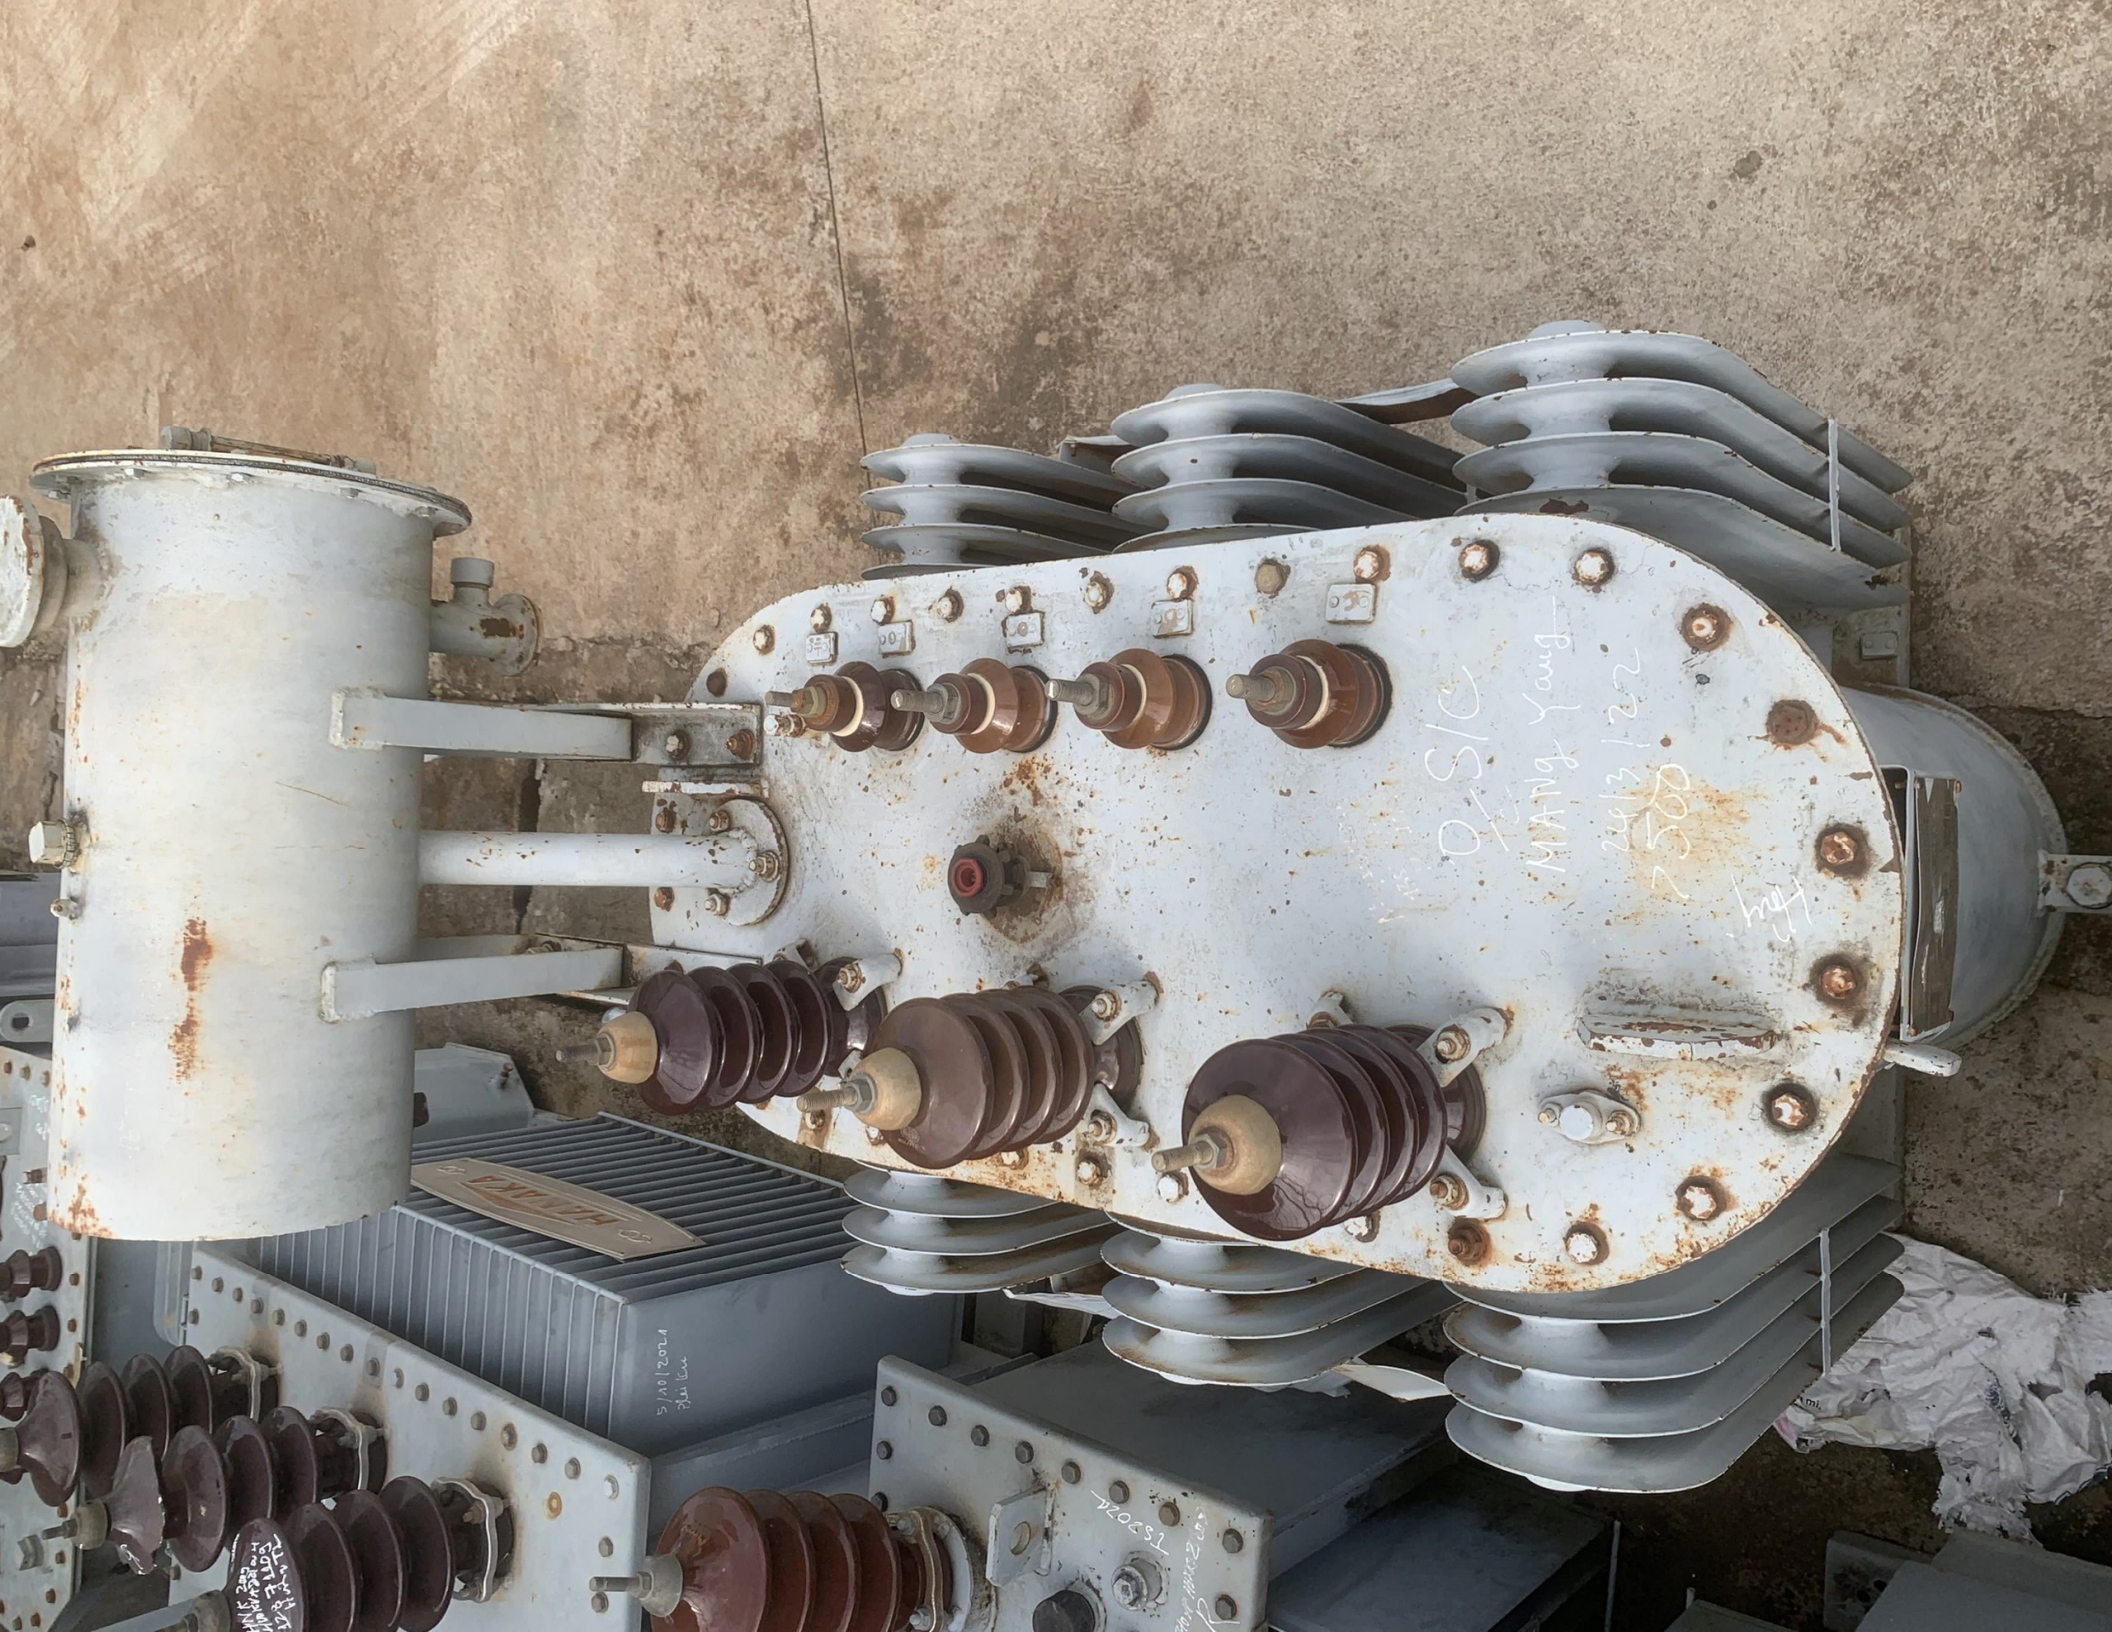

O/S/C
MANG YANG
2213/22
2500
4000

5/10/2014
300 LXX

TS3024
R
2000/1000
1000/1000

TS3024
R
2000/1000
1000/1000














CÔNG TƠ ĐIỆN 3 PHA 4 DÂY
THREE PHASE FOUR WIRE WATTHOUR METER


S/n:  18912953

Kiểu : DT03P-RF
3 x 230/400 V
3 x 10 (100) A
50 Hz



Cấp 1.0
TCVN 7589-21:2007
1000 imp/kWh

DT03P - RF
PDM 225-2012

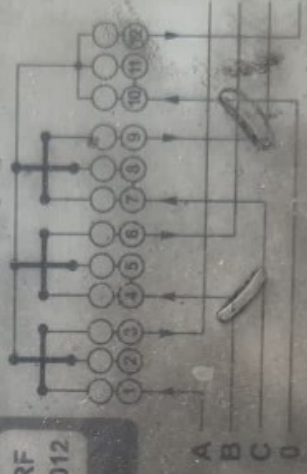

2018

KC





